
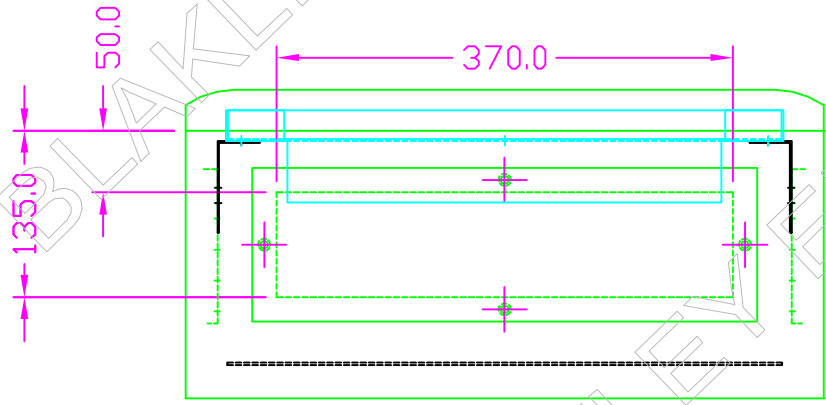
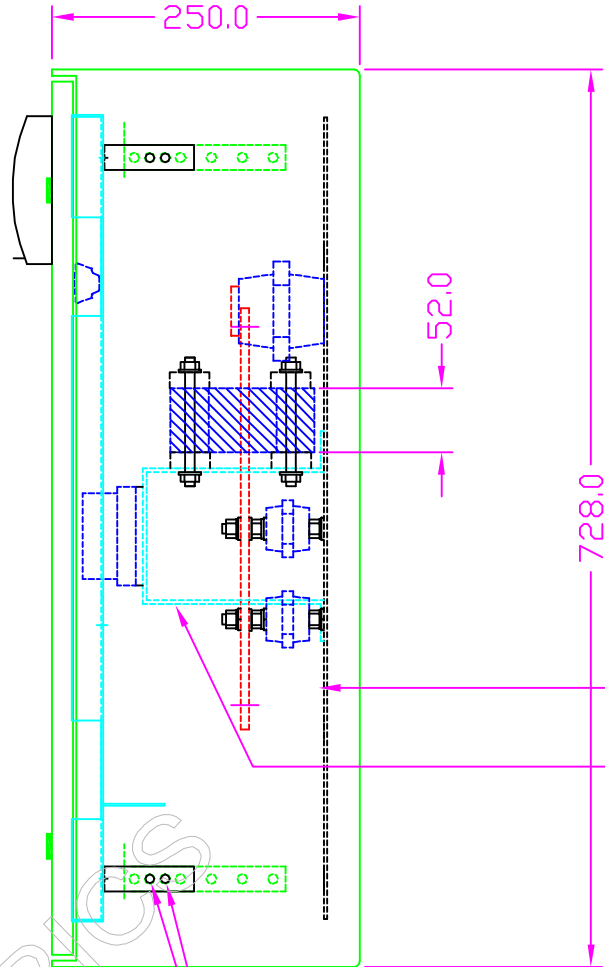



A
B
C
D
E
F

A
B
C
D
E
F

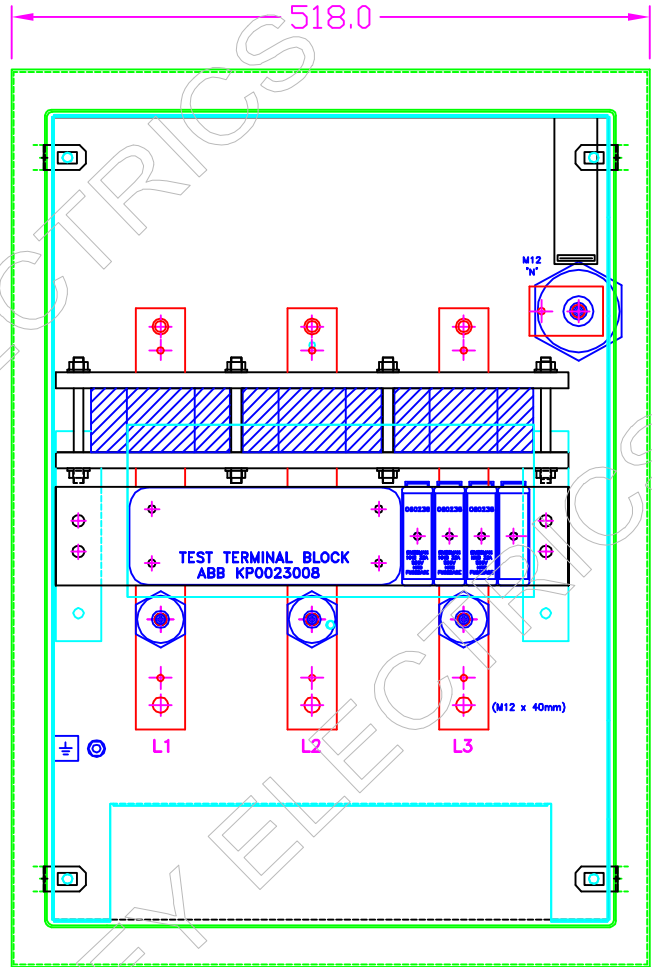

UNDERSIDE OF INCOMING SECTION

BACKPLATE INSULATOR
INSULATE UPRIGHTS USING
BLACK HEATSHRINK



CUSTOMER
INFORMATION
COPY

IN 4 POS.
FIT M6 BRASS INSERTS INTO
FIXING HOLES 2 AND 3 BEFORE
FITTING INSET PLATE BRACKETS.

- NOTES:-
- 1) CT LINKS TO BE HEATSHRINK SLEEVED IN THE APPROPRIATE PHASE COLOUR.
 - 2) POTENTIAL FUSES TO BE FED FROM BOTTOM END OF CT CHAMBER WITH CABLES LONG ENOUGH TO REACH EITHER END OF BARS.
 - 3) CABLING TO NEUTRAL/FUSE HOLDERS TO ENTER BOTTOM OF HOLDERS.
 - 4) FIXING PITCHES EITHER 669(H) x 559(W) OR 769(H) x 459(W) DEPENDING ON ORIENTATION OF WALL MOUNTING LUGS (NOT SHOWN).
 - 5) FUSES TO BE 'NS' (F) PATTERN. NEUTRAL LINK TO BE 'SS' (E) PATTERN.
 - 6) DRILL TO FIT PAXOLIN GLAND PLATE CENTRALLY OVER SLOT IN UNDERSIDE OF UNIT AND FIX USING NYLON SCREWS.
 - 7) NOTE THAT SLOT IN INSET PANEL IS OFFSET TO PERMIT ACCESS TO CT CONNECTIONS.
 - 8) SRBP SUPPORT BRACKETS TO BE INSULATED WITH BLACK HEATSHRINK SLEEVING
 - 9) CONNECTION ARRANGEMENT OF NEUTRAL BARREL TO BE IN ACCORDANCE WITH FIG.26 OF THE ENGINEERING MANUAL USING AN M12X60 STUD.

THIS DRAWING IS THE PROPERTY AND COPYRIGHT OF BLAKLEY ELECTRICS AND MUST NOT WITHOUT THEIR WRITTEN CONSENT BE PASSED ON, COPIED, OR USED FOR ANY OTHER PURPOSE. THIS COPY IS UNCONTROLLED UNLESS OTHERWISE MARKED.

REV:	N	P											
EDR:	6341	6503											
REV:	A	B	C	D	E	F	G	H	J	K	L	M	
EDR:	3622	3737	3812	3912	4467	4676	4678	4912	4918	5543	5618	5833	
UNLESS OTHERWISE STATED:- ALL DIMENSIONS IN MM. TOLERANCES TO H30052 FIXING STANDARD TO H30051 WIRING STANDARD TO H20051 WELDING STANDARD TO QAI 61.										MATERIAL			
DO NOT SCALE THIS DRAWING. IF IN DOUBT, ASK										SIZE			
TITLE GENERAL ASSEMBLY CTC/400/LR										REF. S030096			
										COPY ISSUED			
										ORIGINAL SCALE 1:5			
										DATE 25/03/15			
										BLAKLEY ELECTRICS LIMITED			
										DRAWING No. C11846			
										REVISION P			
										SHEET 1 OF 1			